

SERIES PW5520 IMPACT RESISTANT, VINYL  
PICTURE WINDOW

FLORIDA PRODUCT APPROVAL #5012

1) THIS PRODUCT HAS BEEN DESIGNED & TESTED TO COMPLY WITH THE REQUIREMENTS OF THE CURRENT FLORIDA BUILDING CODE.

2) SHUTTERS ARE NOT REQUIRED WHEN USED IN WIND-BORNE DEBRIS REGIONS.


3) MASONRY ANCHORS MAY BE USED INTO WOOD AS PER TABLES 2 & 3. ALL WOOD BUCKS LESS THAN 1-1/2" THICK ARE TO BE CONSIDERED 1X INSTALLATIONS. 1X WOOD BUCKS ARE OPTIONAL IF UNIT IS INSTALLED DIRECTLY TO SUBSTRATE. WOOD BUCKS DEPICTED AS 2X ARE 1-1/2" THICK OR GREATER. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED TO PROPERLY TRANSFER LOADS TO THE STRUCTURE. WOOD BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD.

4) ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO. USE ANCHORS OF SUFFICIENT LENGTH. ANCHORS AND FRAME CORNERS SHOULD BE SEALED. OVERALL SEALING/FLASHING STRATEGY FOR WATER RESISTANCE OF INSTALLATION SHALL BE DONE BY OTHERS AND IS BEYOND THE SCOPE OF THESE INSTRUCTIONS.


5) SHIMS ARE REQUIRED AT EACH ANCHOR LOCATION WHERE THE PRODUCT IS NOT FLUSH TO THE SUBSTRATE. USE SHIMS CAPABLE OF TRANSFERRING APPLIED LOADS. WOOD BUCKS, BY OTHERS, MUST BE SUFFICIENTLY ANCHORED TO RESIST LOADS IMPOSED ON THEM BY THE WINDOW.

6) THE ANCHORAGE METHODS SHOWN HAVE BEEN DESIGNED TO RESIST THE WIND LOADS CORRESPONDING TO THE REQUIRED DESIGN PRESSURE. THE 33-1/3% STRESS INCREASE HAS NOT BEEN USED IN THE DESIGN OF THIS PRODUCT. THE 1.6 LOAD DURATION FACTOR WAS USED FOR THE EVALUATION OF ANCHORS INTO WOOD. ANCHORS THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE FOR CORROSION RESISTANCE.


7) FRAME FLANGES OR INTEGRAL FINIS MAY BE TRIMMED IN-FIELD TO CREATE AN EQUAL-LEG FRAME.

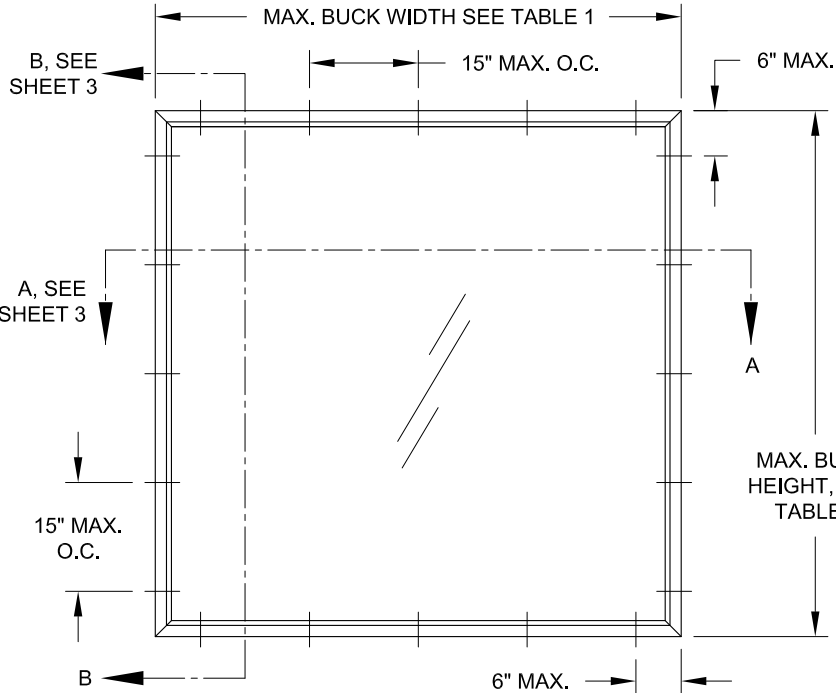

TYP. EQUAL-LEG/BOX & FLANGE  
FRAME (SHAPES SIMILAR)

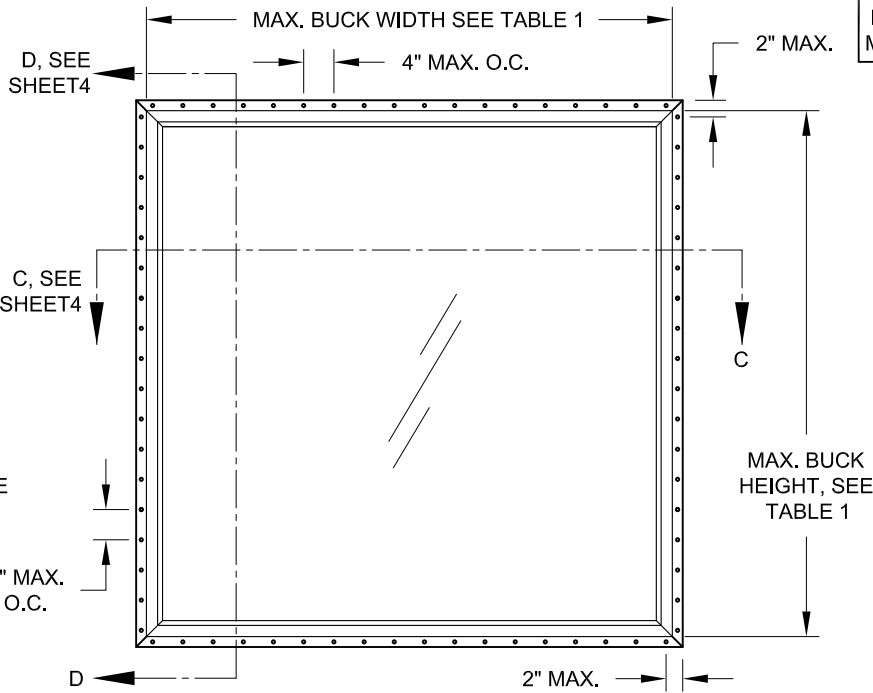

TYP. INTEGRAL FIN & J-CHANNEL  
FRAME (SHAPES SIMILAR)

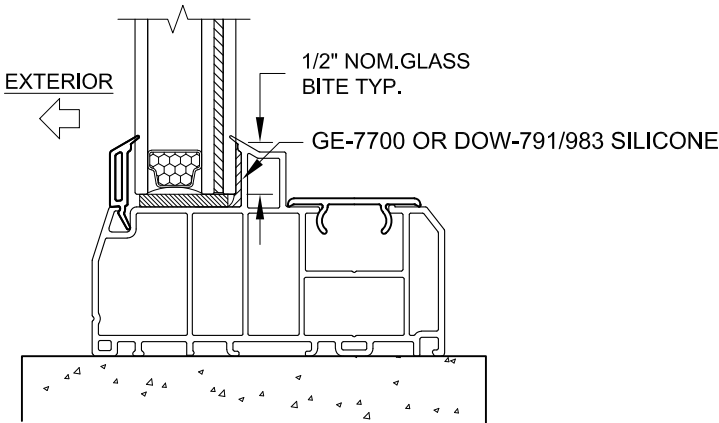

TYP. GLAZING DETAIL

ALL TEMPERED AND/OR LAMINATED GLASS OPTIONS IN THIS APPROVAL HAVE BEEN CERTIFIED BY THE SGCC FOR COMPLIANCE TO ANSI Z97.1, CLASS A AND CPSC 16 CFR 1201, CATEGORY II. THIS INCLUDES LAMINATED GLASS THAT IS MANUFACTURED WITH ANNEALED GLASS PLIES. FOR APPLICATIONS WHERE THE WINDOW IS BEING USED AS A GUARD, HEAT STRENGTHENED OR TEMPERED LAMINATED GLASS MUST BE USED.

DESIGN PRESSURE RATING  
SEE TABLE 1

IMPACT RATING  
RATED FOR LARGE & SMALL  
MISSILE IMPACT RESISTANCE  
MISSILE LEVEL D, WINDZONE 4

SHAPES MAY BE USED BY INSCRIBING THE SHAPE IN A BLOCK AND OBTAINING DESIGN PRESSURES FOR THAT BLOCK SIZE FROM THE TABLE ON THIS SHEET.

TABLE 1:

Window Buck Size		Design Pressure		Product Rating
Width	Height	(+) psf	(-) psf	
84	54	65.0*	65.0*	CW-PG70
84	54	70.0	70.0	CW-PG70
84	72	70.0	70.0	CW-PG70
96	63	70.0	70.0	CW-PG70
75	48	50.0	50.0	CW-PG50
36	72	50.0	50.0	CW-PG50


\* IMPACT/CYCLE DESIGN PRESSURE IS LIMITED FOR UNITS USING AN ANNEALED GLASS CAP.

PREPARED BY A. LYNN MILLER  
1070 TECHNOLOGY DRIVE  
N. VENICE, FL 34275  
(941) 480-1600

**PCT**  
Custom Windows and Doors  
1070 TECHNOLOGY DRIVE  
N. VENICE, FL 34275  
(941) 480-1600

REGISTRATION #29296  
COPYRIGHT © 2023 PGT, INC., LIMITED LICENSE  
TO MAKE COPIES FOR PERMITTING.

VINYL PICTURE WINDOW (LM)  
ELEVATION & GENERAL NOTES  
JENS ROSOWSKI  
06/12/11  
Date  
By  
DWC  
No.  
1 OF 4  
Sheet  
PW5520  
Series  
Desc.  
Title

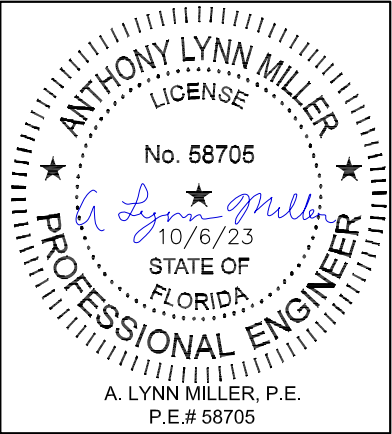

LMY  
By:  
10/5/23  
Date  
TRIM FIN/FLANGE AND  
ANSI Z97.1 NOTES  
Rev

TABLE 2: ANCHORS INSTALLED THROUGH FRAME

Anchor	Substrate	Min. Edge Distance	Min. Embedment
#10 SMS (steel, 18-8 S.S. or 410 S.S.) Max. DP of 50.0 psf	P.T. Southern Pine (SG=0.55)	7/16"	1-3/8"
	Steel, A36	3/8"	0.050"
	Steel Stud, A653 Gr. 33	3/8"	0.0346" (20 Ga.)
	Aluminum, 6063-T5	3/8"	0.0713" (14 Ga.)
#12 SMS (steel, 18-8 S.S. or 410 S.S.)	P.T. Southern Pine (SG=0.55)	9/16"	1-3/8"
	Steel, A36	3/8"	0.050"
	Steel Stud, A653 Gr. 33	3/8"	0.0346" (20 Ga.)
	Aluminum, 6063-T5	3/8"	0.0713" (14 Ga.)
3/16" Ultracon+ Max. DP of 50.0 psf	P.T. Southern Pine (SG=0.55)	7/16"	1-3/8"
	Concrete (min. 3 ksi)	1"	1-3/8"
	UngROUTED CMU, (ASTM C-90)	1"	1-1/4"
1/4" Ultracon+	P.T. Southern Pine (SG=0.55)	1"	1-3/8"
	Concrete (min. 3 ksi)	1-3/16"	1-3/4"
	UngROUTED CMU, (ASTM C-90)	1"	1-1/4"
1/4" Crete-Flex (410 S.S.)	P.T. Southern Pine (SG=0.55)	1"	1-3/8"
	Concrete (min. 3.35 ksi)	1"	1-3/4"
	UngROUTED CMU, (ASTM C-90)	2-1/2"	1-1/4"
1/4" Aggre-Gator (18-8 S.S.)	Concrete (min. 3.275 ksi)	1-1/2"	1-3/8"
	P.T. Southern Pine (SG=0.55)	1"	1-3/8"
	UngROUTED CMU, (ASTM C-90)	2"	1-1/4"

- 1) "UNGROUTED CMU" VALUES MAY BE USED FOR GROUTED CMU APPLICATIONS.
- 2) PANHEAD, FLATHEAD OR HEXHEAD ARE ACCEPTABLE.
- 3) ANCHOR LENGTH TO BE SO THAT A MIN. OF 3 THREADS EXTEND BEYOND THE METAL SUBSTRATE.

VISIBLE LIGHT FORMULAS

WIDTH: BUCK WIDTH - 4-5/16"





HEIGHT: BUCK HEIGHT - 4-5/16"

VISIBLE LIGHT WIDTH OR HEIGHT  
(ALSO REFERRED TO AS DAYLIGHT  
OPENING) IS MEASURED FROM  
BEADING TO BEADING.

TABLE 3: ANCHORS INSTALLED THROUGH INTEGRAL FIN

Anchor	Substrate	Min. Edge Distance	Min. Embedment
2-1/2" x .131" Common Nail Max. DP of 50.0	P.T. Southern Pine (SG=.55)	9/16"	2-7/16"
2-1/2" x .131" Ring-shank Nail	P.T. Southern Pine (SG=.55)	9/16"	2-7/16"
2-1/2" x .145" Roofing Nail	P.T. Southern Pine (SG=.55)	9/16"	2-7/16"
#10 SMS (steel, 18-8 S.S. or 410 S.S.)	P.T. Southern Pine (SG=.55)	3/4"	1-3/8"
	Aluminum, 6063-T5	3/8"	0.050"
	Steel Stud, Gr. 33	3/8"	0.0346" (20 Ga.)
	Steel, A36	3/8"	0.050"

1) PANHEAD, FLATHEAD OR HEXHEAD ARE ACCEPTABLE.

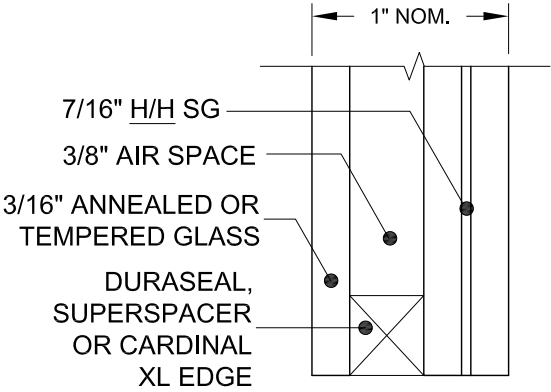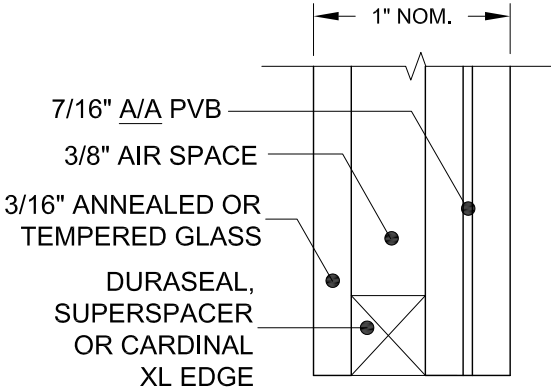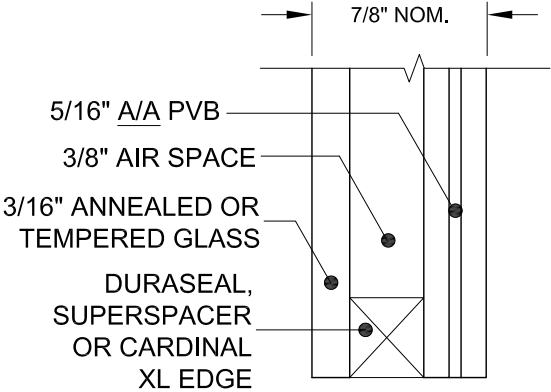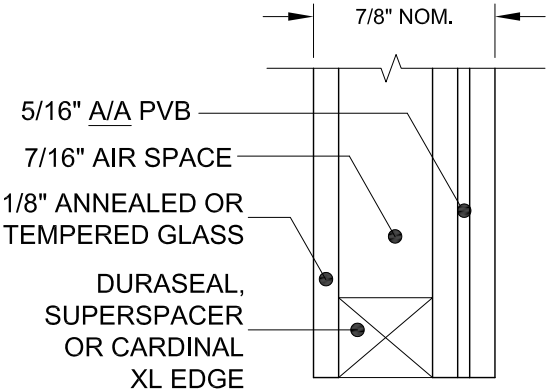

GLAZING TYPES

PVB = KURARAY TROSIFOL PVB INTERLAYER BY KURARAY AMERICA, INC.  
A = ANNEALED  
H = HEAT STRENGTHENED

PGT

Custom Windows and Doors

1070 TECHNOLOGY DRIVE  
N. VENICE, FL 34275  
(941) 480-1600

PREPARED BY A. LYNN MILLER  
1070 TECHNOLOGY DRIVE  
N. VENICE, FL 34275  
(941) 480-1600

REGISTRATION #29296  
COPYRIGHT © 2023 PGT, INC., LIMITED LICENSE  
TO MAKE COPIES FOR PERMITTING.

VINYL PICTURE WINDOW (LM)

ANCHORS AND GLAZING  
DETAILS

06/12/11

JENS ROSOWSKI


Rev. #


D

2 OF 4


PW5520

PW5520FPA-LM

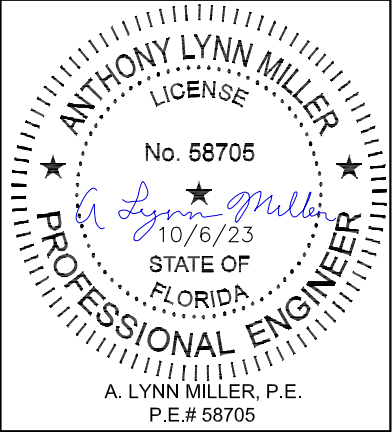


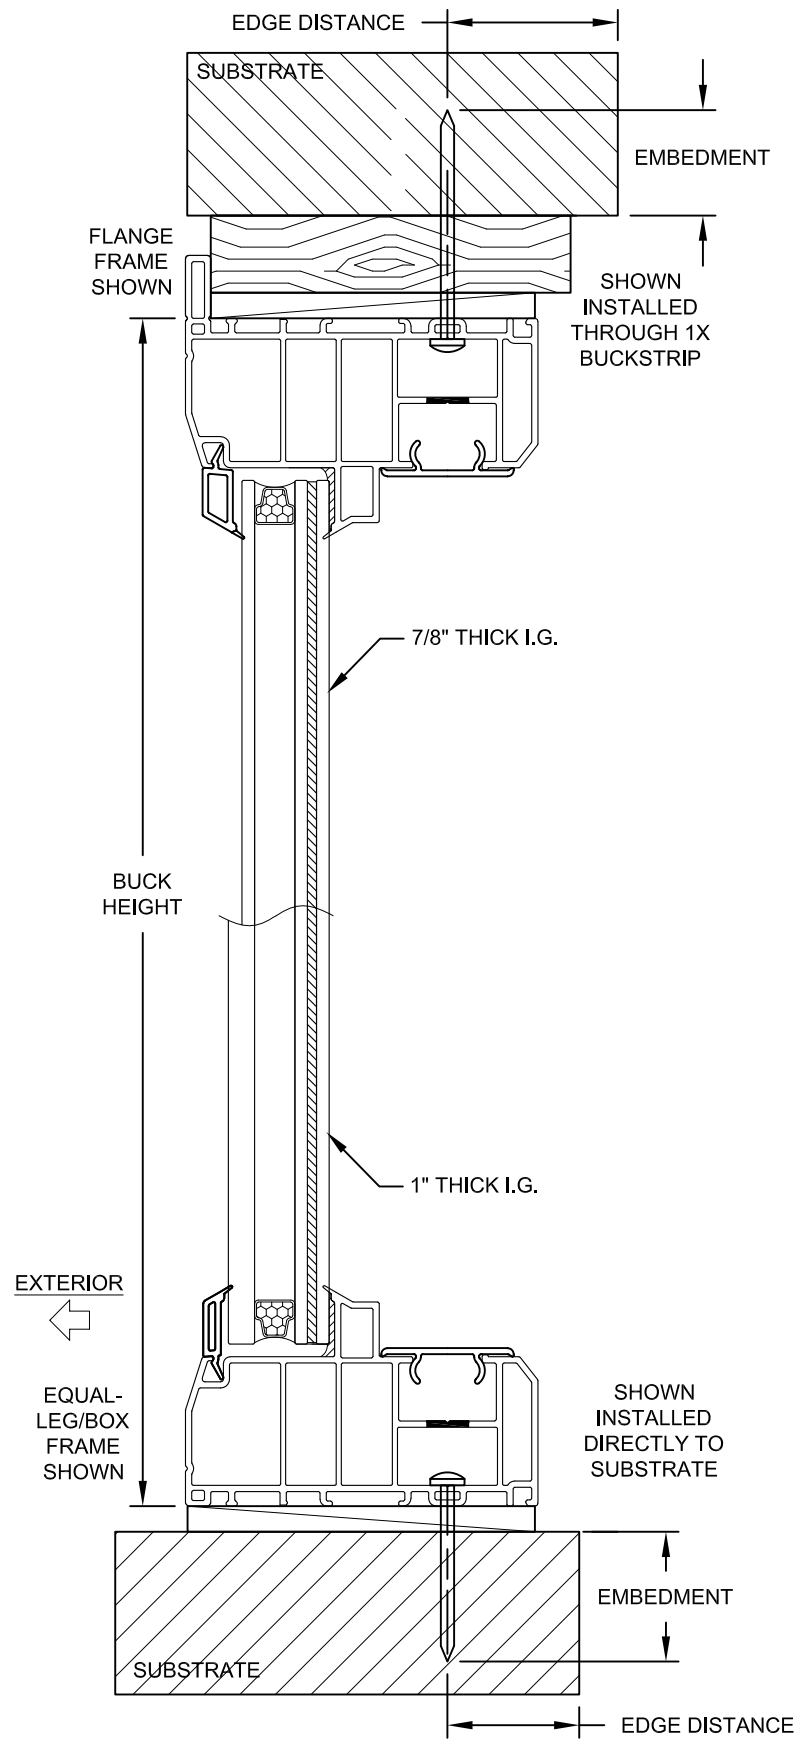

**VERTICAL SECTION B-B**

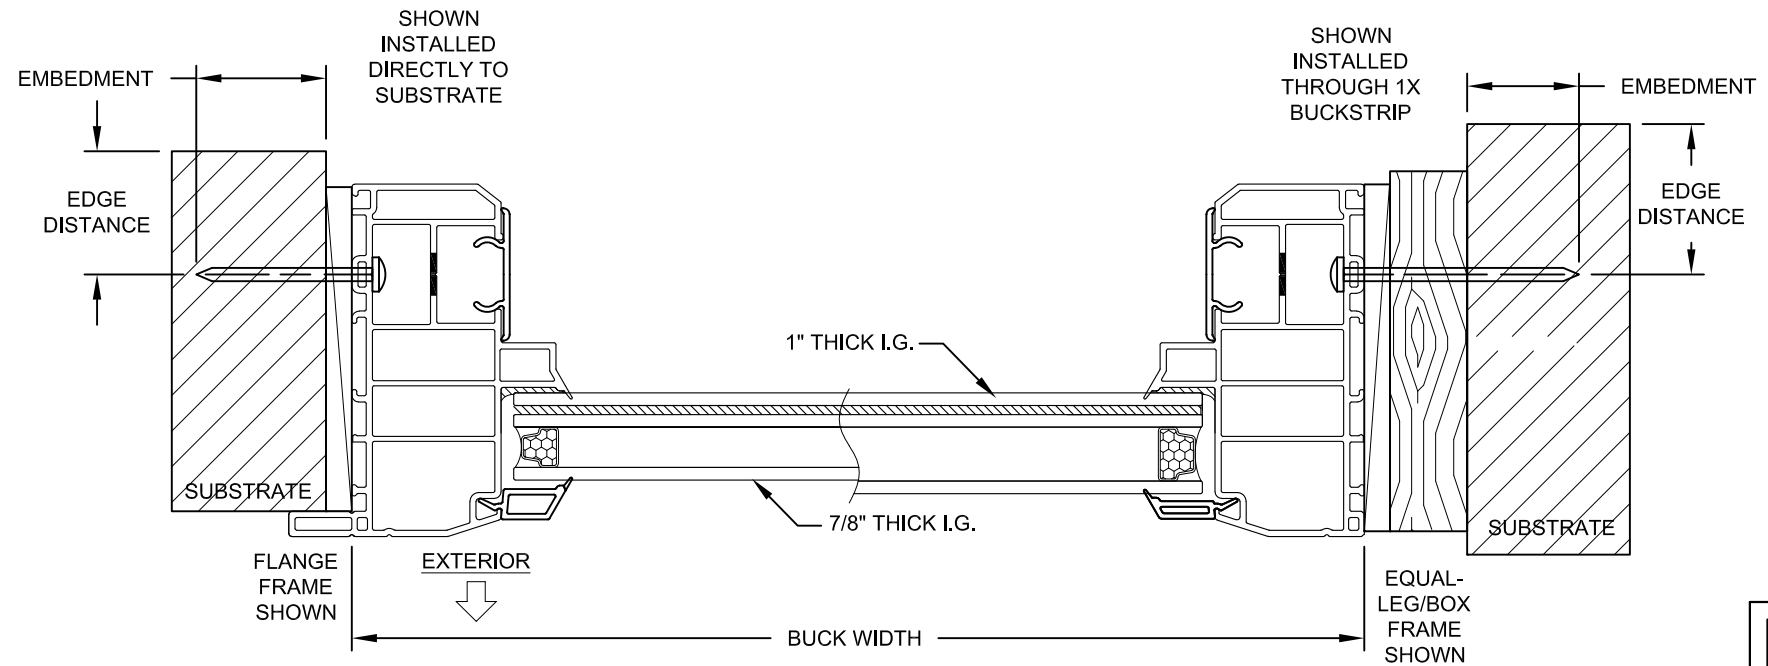

**HORIZONTAL SECTION A-A**

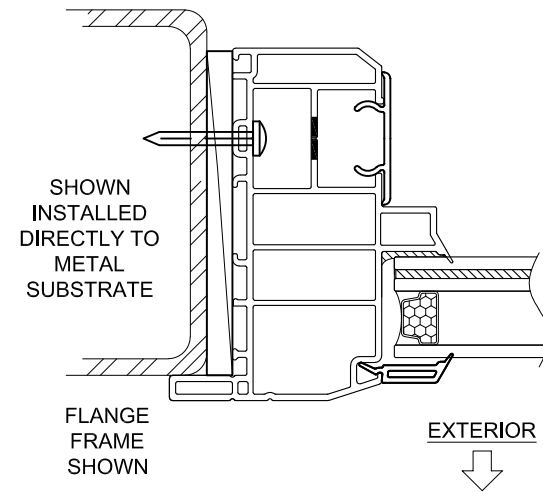


**INSTALLATION NOTES:**


- 1) SEE SHEET 1 FOR SPACING REQUIREMENTS.
- 2) SEE TABLE(S) ON SHEET 2 FOR ANCHORAGE AND SUBSTRATE REQUIREMENTS.
- 3) MAX. SHIM THICKNESS TO BE 1/4".
- 4) GLASS SHOWN IS FOR ILLUSTRATIVE PURPOSES ONLY AND MAY DIFFER TO MEET DESIGN REQUIREMENTS.

<p>PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600</p>		<p>REGISTRATION #29296 COPYRIGHT © 2023 PGT, INC., LIMITED LICENSE TO MAKE COPIES FOR PERMITTING.</p>		<p>06/12/11 Date</p>	<p>JENS ROSOWSKI By</p>	<p>D Rev. #</p>
		<p>VINYL PICTURE WINDOW (LM) FLANGE/EQUAL-LEG INSTALLATION</p>		<p>PW5520FPA-LM DWG No.</p>	<p>3 OF 4 Sheet</p>	<p>D Rev. #</p>
<p>PGT Custom Windows and Doors 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600</p>		<p>VINYL PICTURE WINDOW (LM) FLANGE/EQUAL-LEG INSTALLATION</p>		<p>PW5520 Series</p>	<p>3 OF 4 Sheet</p>	<p>D Rev. #</p>


ANTHONY LYNN MILLER  
LICENSE  
No. 58705  
10/6/23  
STATE OF FLORIDA  
PROFESSIONAL ENGINEER  
A. LYNN MILLER, P.E.  
P.E.# 58705

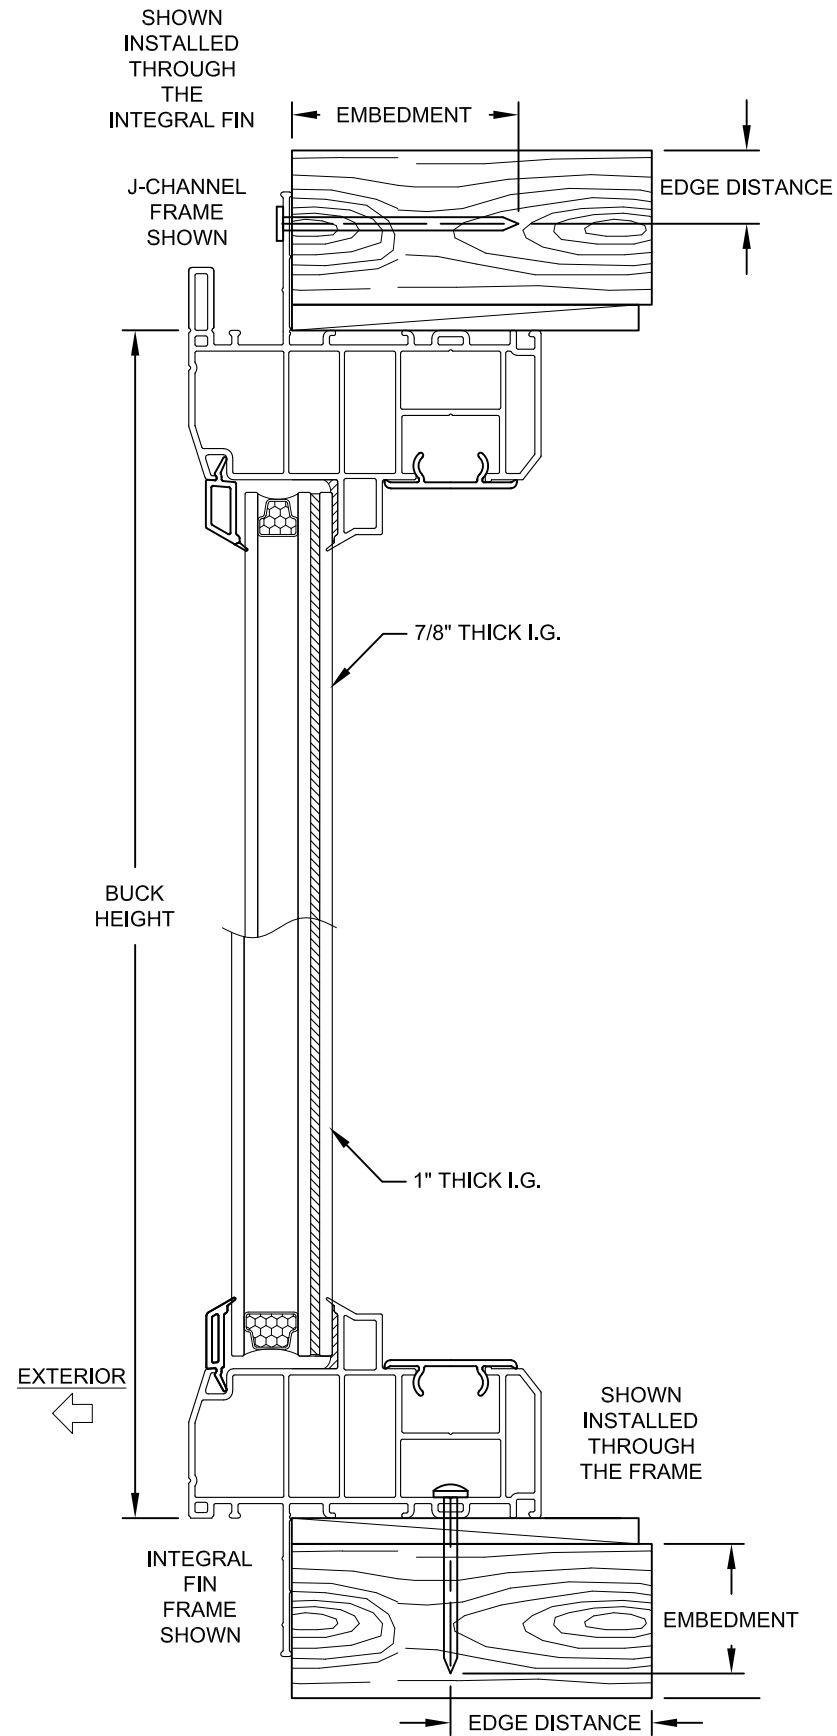


**VERTICAL SECTION D-D**

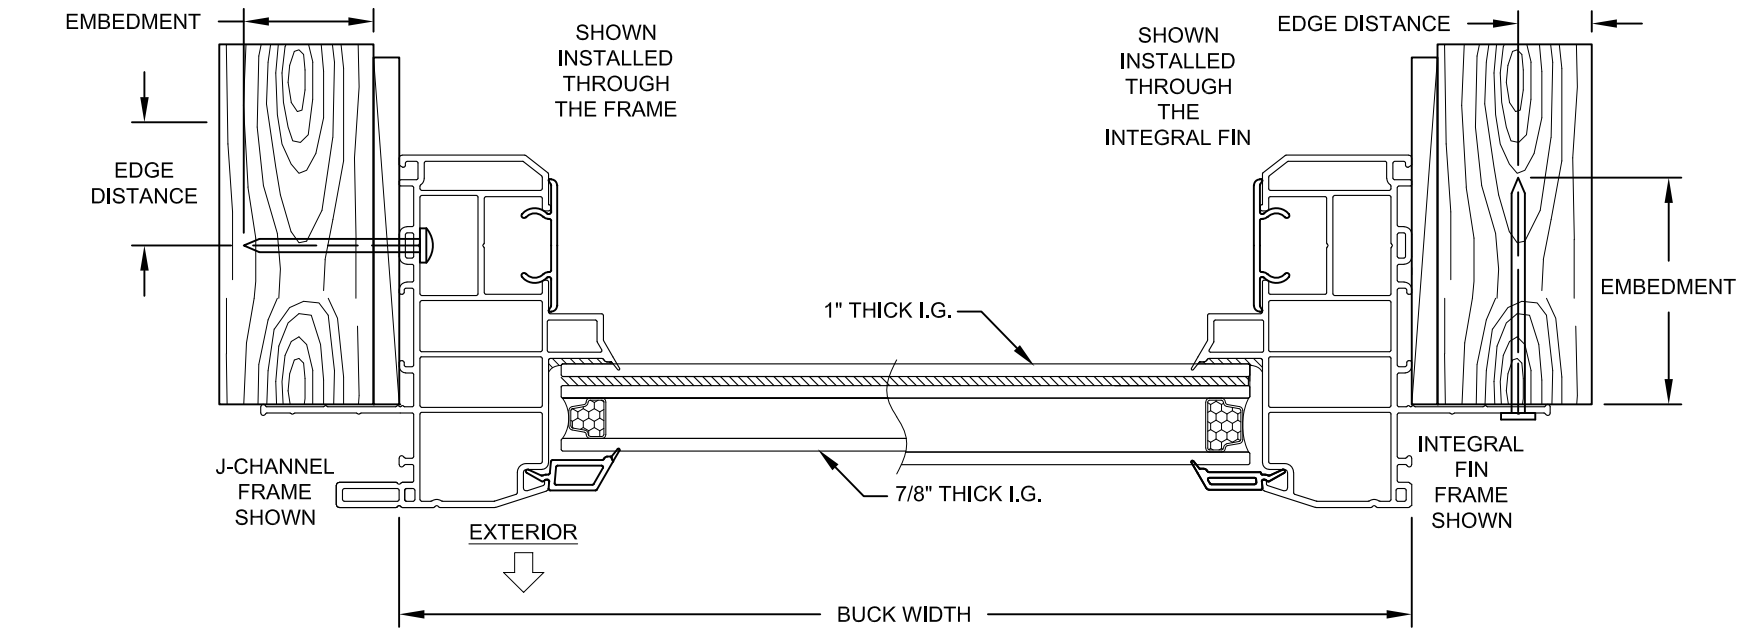

**HORIZONTAL SECTION C-C**

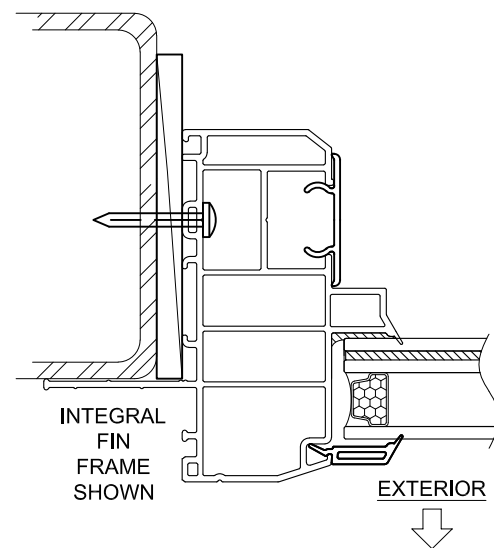

INSTALLATION THROUGH THE FRAME, INTO METAL

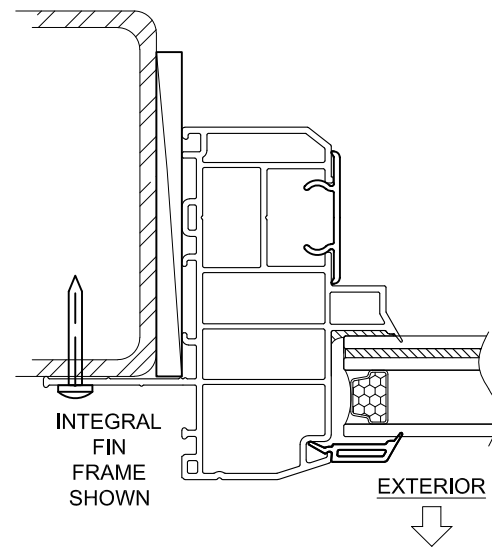

INSTALLATION THROUGH THE INTEGRAL FIN, INTO METAL

HYBRID CONFIGURATIONS  
(FLANGE FRAME/FIN FRAME)  
ALLOWED WITH MULLION  
INSTALLATION, SEE PAGE 3  
FOR FLANGE FRAME  
INSTALLATION DETAILS.

**INSTALLATION NOTES:**

- 1) SEE SHEET 1 FOR SPACING REQUIREMENTS.
- 2) SEE TABLE(S) ON SHEET 2 FOR ANCHORAGE AND SUBSTRATE REQUIREMENTS.
- 3) MAX. SHIM THICKNESS TO BE 1/4".
- 4) GLASS SHOWN IS FOR ILLUSTRATIVE PURPOSES ONLY AND MAY DIFFER TO MEET DESIGN REQUIREMENTS.

PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600		REGISTRATION #29296 COPYRIGHT © 2023 PGT, INC., LIMITED LICENSE TO MAKE COPIES FOR PERMITTING.		06/12/11 Date	JENS ROSOWSKI By	PW5520FPA-LM No.	D Rev. #
<b>PGT</b> Custom Windows and Doors		1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600		VINYL PICTURE WINDOW (LM)		4 OF 4 Sheet	PW5520 Series
FIN INSATALLATION		FIN INSATALLATION		FIN INSATALLATION		FIN INSATALLATION	

ANTHONY LYNN MILLER  
LICENSE  
No. 58705  
10/6/23  
STATE OF FLORIDA  
PROFESSIONAL ENGINEER  
A. LYNN MILLER, P.E.  
P.E.# 58705